


IPS FOR UP TO 6 LINES WITHOUT AFTC NON RE / RE AREA FOR PI DOUBLE LINE
AS PER RDSO SPN NO. RDSO/SPN/165/2004, REF: DRG. NO. SDO/IPS/SMPS/PI/NRE/003

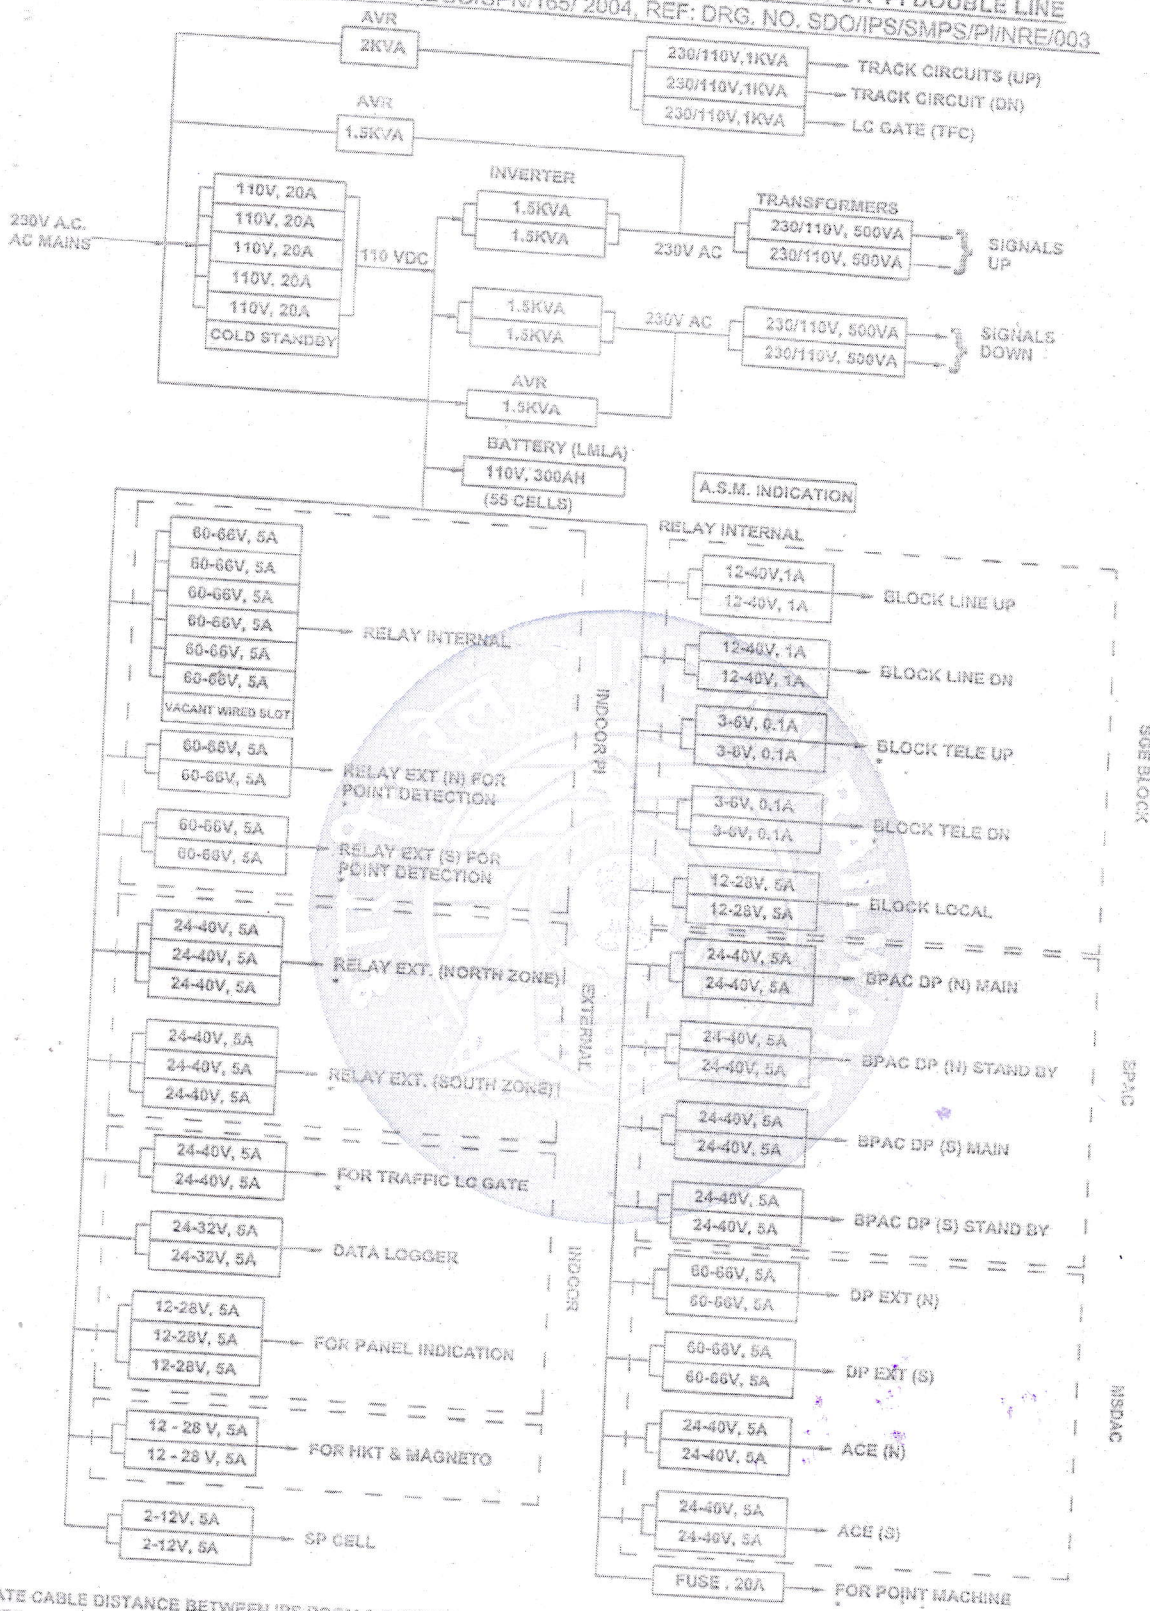

NOTE
APPROXIMATE CABLE DISTANCE BETWEEN IPS ROOM & BATTERY BANK 10 METRS.
SUPPLY INCLUDES SPDS AND FIXING ARRANGEMENT AS PER RDSO SPECIFICATIONS.
SUPPLY INCLUDES TOOLS AND SPARE AS PER RDSO SPECIFICATIONS.
SCOPE OF SUPPLY, INSTALLATION & COMMISSIONING SHALL BE AS PER RDSO LETTER NO. STS/E/PS/GEN/DT.03.04.08 EXCEPT SUPPLY OF 12C, 1.55sq. mm SIGNALLING CABLE FOR CABLES TO STATUS MONITORING PANEL WILL BE SUPPLIED BY RAILWAY FREE OF COST.

अमिर चन्द
Amir Chand

उप मुख्य सामग्री प्रबंधक/सा.एवं नि.
Dy Chief Materials Manager/G&C
पश्चिम मध्य रेल, जबलपुर

EXTERNAL SUPPLY				WEST CENTRAL RAILWAY	
DRAWN BY	CHECKED BY	CHECKED BY	APPROVED BY	SIGNAL & TELECOMMUNICATIONS	
SS/ED	ESTER/SIG	DY CSTER/SIG	CSE	IPS FOR UP TO 6 LINES WITHOUT AFTC FOR RE / NON RE AREA FOR PI DOUBLE LINE	
				DRG. NO. WCR/N-WG/PER/LINE/IPS/03	